

Waste-to-energy plant

Reno Nord Aalborg, Denmark




In October 2006 one of the most modern and efficient waste-to-energy plants in Denmark was handed over to I/S Reno Nord.

The new furnace line 4 has been built to replace the two old furnace lines 1 and 2, which were supplied in 1981. The existing furnace line 3, supplied in 1991, will be kept as a replacement.

The complete machinery has been supplied by a consortium consisting of Babcock & Wilcox Vølund (BWV) and the French company LAB S.A. (LAB). BWV has supplied the furnace/boiler line complete with auxiliary equipment, and LAB has supplied a complete flue gas cleaning plant with wet scrubber. BWV's sub-supplier has supplied a complete turbine/generator set. The concrete work has been carried out by the client.



Combined Heat and Power

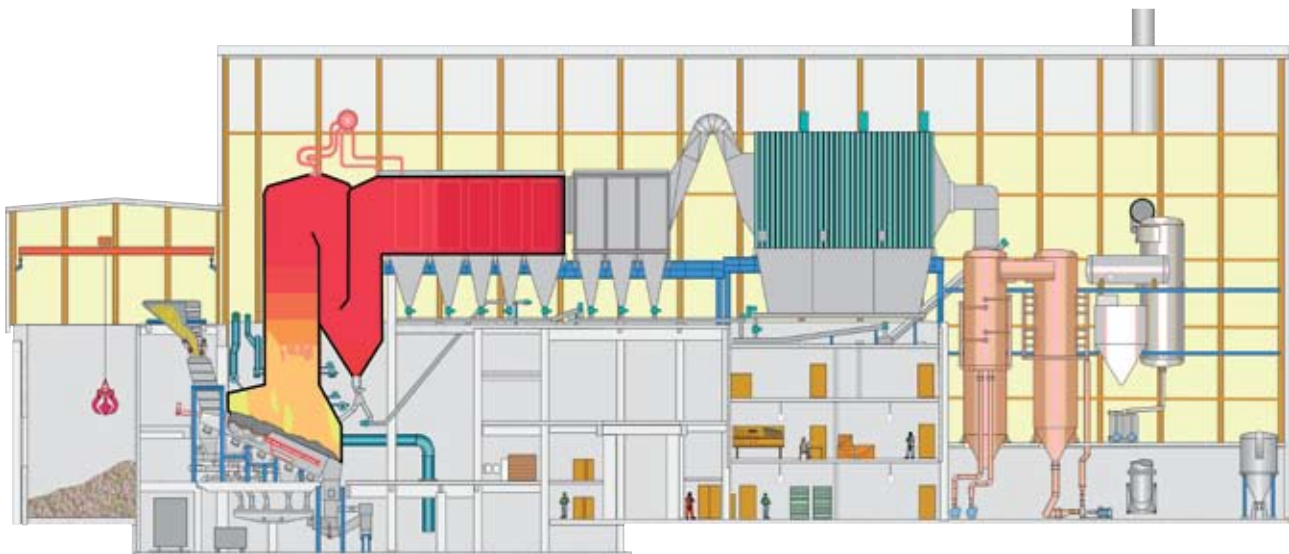

The nominal capacity of the plant is 20 t/h waste at a calorific value of 12 MJ/kg, corresponding to approx. 160,000 t/year. The boiler generates 80 t/h steam at 50 bar, 425°C.

16,000 houses with electricity, and approx. 30,000 houses with district heating.

BWV's scope of supply

BWV's supply includes a furnace/boiler with economiser, an ash/clinker system, a DeNOx system (dosing of ammonium to the boiler first pass), an electrical and DCS system, and an electrostatic precipitator after the economiser. Furthermore, the steel structure of the building was supplied as an integrated part of the boiler's steel frame.



Technology

The plant is equipped with an air-cooled grate type BS, prepared for later conversion to water-cooling and with feeding of waste by a so-called pusher, which ensures homogenous feeding without the risk of backfire.

The turbine generates approx. 18 MW of electricity, which will be fed into the main grid. Furthermore, the plant will supply approx. 43 MW of heat to the district heating network in Aalborg. The efficiency is approx. 100%, and the energy produced will supply approx.

Guarantee test

Process parameter	Unit	Guarantee values	300-hour test
Waste capacity	t/h	20	21,72
Calorific value, lower	MJ/kg	12	11,28
Steam production	Kg/s	22,42	22,55
Steam temperature	°C	425	423
Steam pressure	bar	50	48,6
Input efficiency	MW	66,66	67,69
Electricity produced	MW	17,918	18,232
Thermal efficiency	%	85,56	87,1
Electrical efficiency	%	26,88	26,93
TOC, bottom ash	%	< 20	< 0,23
Flue gas temperature before superheater	°C	620	530
Outlet temperature, boiler	°C	180	181

Babcock & Wilcox Vølund A/S

Falkevej 2 • DK-6705 Esbjerg Ø • Denmark • Tel: +45 76 14 34 00 • Fax: +45 76 14 36 00
We have branch offices in Aarhus and Glostrup/Copenhagen, Denmark.

The information contained herein is provided for general information purposes only and is not intended or to be construed as a warranty, an offer, or any representation of contractual or other legal liability. Babcock & Wilcox Vølund A/S is 100% owned by Babcock & Wilcox Power Generation Group, Inc. in Barberton, Ohio, USA – a subsidiary of McDermott International, Inc. © 2008 Babcock & Wilcox Vølund A/S. All rights reserved.